PROPOSED SEWAGE SYSTEM FOR DOUBLE "D" RESTAURANT

SEABROOK N. H
SCALE 1"=20 MAY 1970
PARKER SURVEY ASSOC INC
977 SEABROOK, N.H

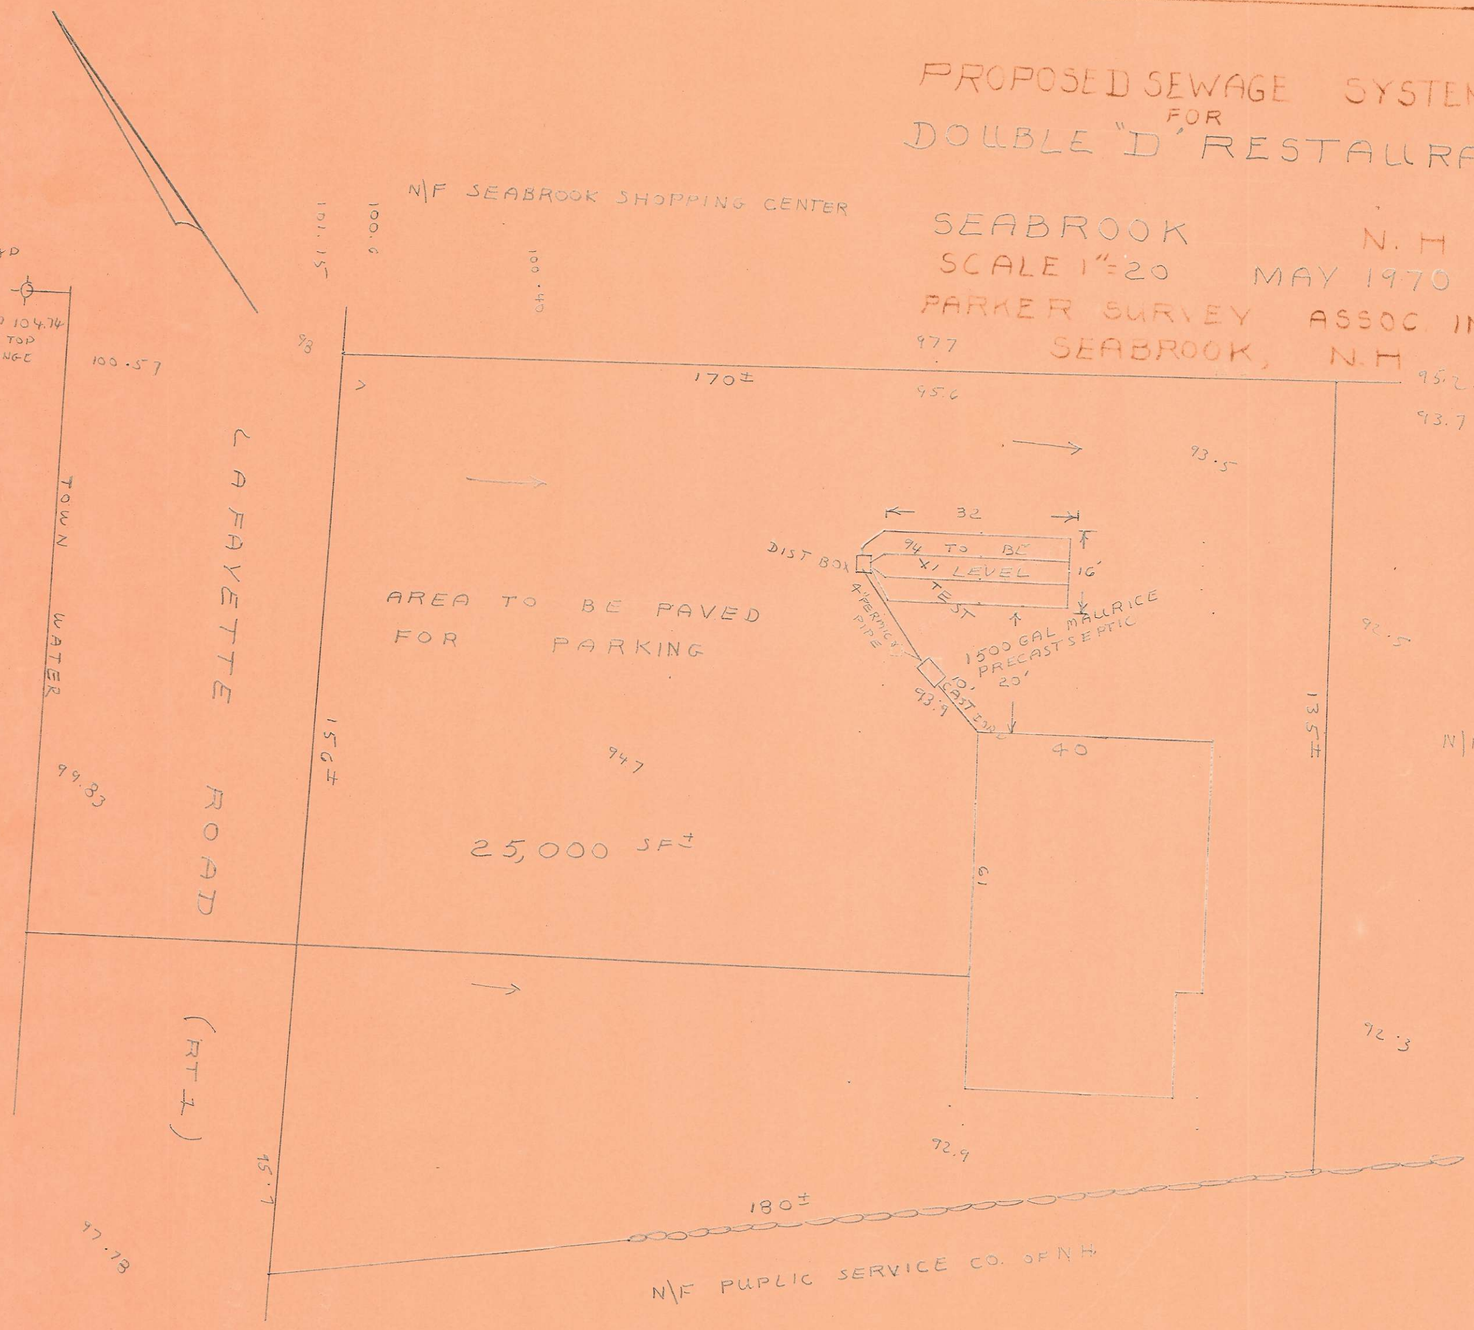

ESTIMATED WASTE PER/24 HR KITCHEN 200 GAL
TOILETS 700 "
TOTAL 900 GAL/DAY

PERC. 5 MIN/IN USE ONE SQ. FT. FIELD PER GAL WASTE → 900 ÷ 2.2 = 409 SFS
↳ X 25% SAFTY FACTOR = 502 S.F. FIELD

TEST PIT & SOIL LOG

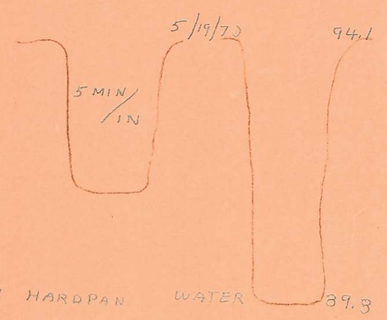

PARTIAL SECTION OF LEACHING BED

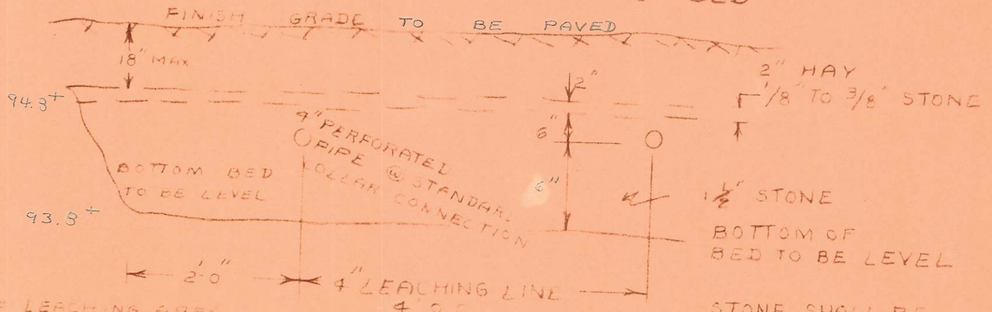

BOTTOM OF LEACHING AREA MIN OF 4 FT ABOVE HIGH WATER TABLE F.B FT CLAY, HARDPAN OR LEDGE

STONE SHALL BE WASHED CRUSHED STONE OR WASHED GRAVEL FREE FROM IRON, FINES, DUST & ORGANIC MATTER AS LAID

807